



Cryptologic Technician (Technical) - B550

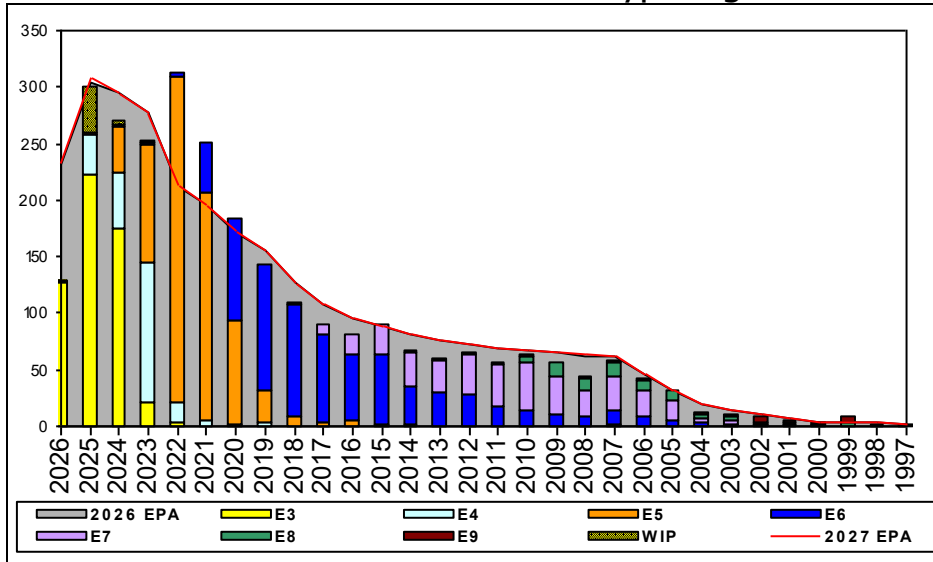

Sea Shore Flow		
TOUR	SEA	SHORE
1ST	42	36
2ND	36	36
3RD	36	36
4TH	36	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA										
PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA	
E1-3	81.1%	223	275	#####	82	6	108.5%	305	281	
E4	55.9%	170	304	42.2%	27	64	53.5%	197	368	
E5	123.9%	477	385	66.1%	251	380	95.2%	728	765	
E6	88.8%	277	312	102.1%	390	382	96.1%	667	694	
E7	94.0%	158	168	84.4%	189	224	88.5%	347	392	
E8	75.0%	30	40	90.7%	49	54	84.0%	79	94	
E9	83.3%	5	6	100.0%	23	23	96.6%	28	29	
Total	89.9%	1340	1490	89.2%	1011	1133	89.6%	2351	2623	

TIS to PG Years	Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
	ALL Navy	TIS	2.2	4.0	8.7	13.8	17.9	21.8
TIG to PG Years	CTT	TIS	2.1	2.9	6.8	12.1	16.9	20.7
	ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
	CTT	TIG	1.0	1.1	3.7	5.3	5.3	4.8

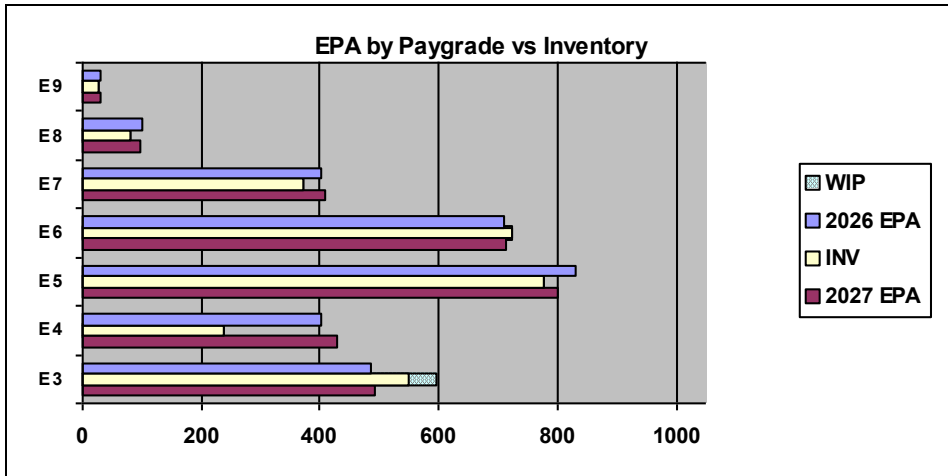

Zone Info	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	103.0%	83.0%	88.0%	85.0%	73.0%	94.0%
FYTD RENL Rate:	80.9%	59.3%	81.0%	94.6%	28.4%	70.3%

NOTES

94% MANNED OVERALL & 90% MANNED TO FORCE STRUCTURE
RATING IS UNDERMANNED.

PACT Rating; PACT candidates should contact the CTT TECHAD early to discuss clearance requirements. Rating conversions will be considered on a case by case basis. Review conversion checklist on NyNavyHR prior to submitting conversion request.

RC2AC for CTT only; quotas are posted in CWAY.

ASVAB requirements:
 CTT 4YO: AR + 2MK + GS >= 212 or AR+MK+CT >= 159 and CT >=60
 CTT 6YO: AR + MK + EI + GS >= 223 or AR+MK+CT >=162 and CT >=60

SDIP, SRB, and SDAP info available at
https://www.mynavyhr.navy.mil/?utm_source=mnpp%20public
 Contact CTT ECM at eric.l.stone16.mil@us.navy.mil

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	113%	59%	94%	102%	92%	82%	93%	94%
EPA (FY26)	486	401	829	711	401	99	30	2957
INVENTORY	550	238	777	723	370	81	28	2767
EPA (FY27)	492	430	800	712	409	98	30	2971
% INV to FY27 EPA	112%	55%	97%	102%	90%	83%	93%	93%
INV + WIP / FY26 EPA	123%							95%
INVENTORY	597	47 ← E-3 and Below WIP						2814
INV + WIP / FY26 EPA	121%							95%