
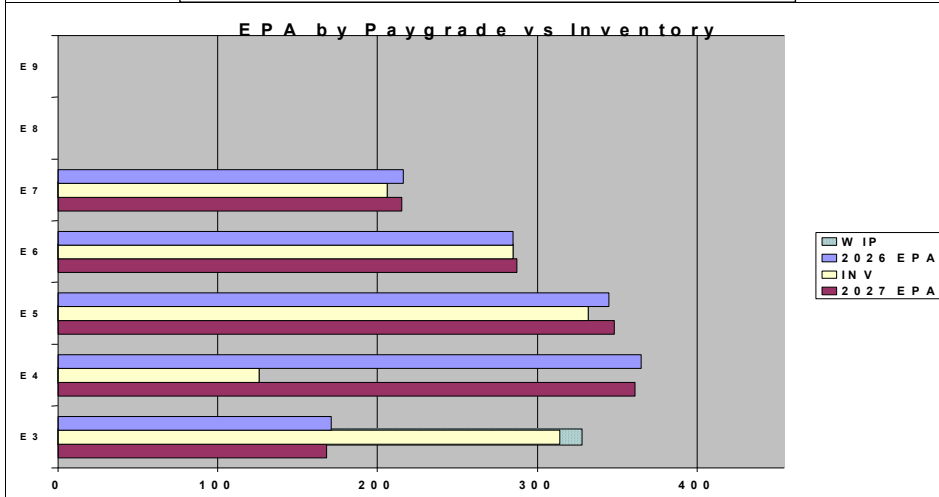


Gas Turbine Systems Technician, Electrical - B121

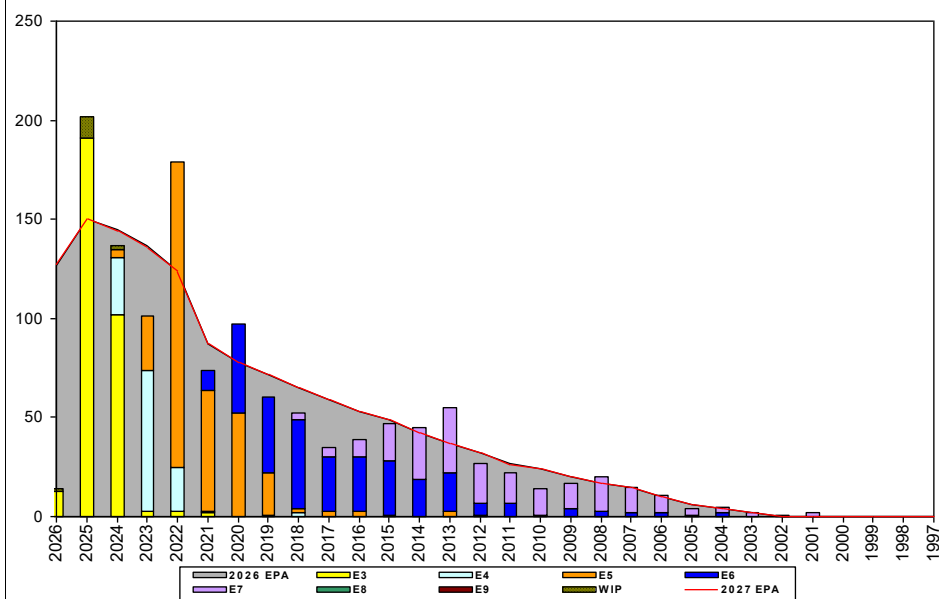

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	184%	35%	96%	100%	95%			91%
EPA (FY26)	171	365	345	285	216			1382
INVENTORY	314	126	332	285	206			1263
EPA (FY27)	168	361	348	287	215			1379
% INV to FY27 EPA	187%	35%	95%	99%	96%			92%
INV +WIP / FY26 EPA	192%							92%
INVENTORY	328	14	← E-3 and Below WIP					1277
INV +WIP / FY26 EPA	195%							93%

Sea Shore Flow

TOUR	SEA	SHORE
1ST	52	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA

PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
E1-3	126.3%	120	95	800.0%	8	1	133.3%	128	96
E4	35.6%	116	326	31.8%	7	22	35.3%	123	348
E5	161.7%	262	162	39.1%	59	151	102.6%	321	313
E6	63.4%	109	172	170.2%	160	94	101.1%	269	266
E7	113.9%	123	108	74.5%	73	98	95.1%	196	206
E8									
E9									
Total	84.6%	730	863	83.9%	307	366	84.4%	1037	1229

TIS to PG Years

Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS	2.2	3.9	8.7	13.8	17.8	21.7
GSE	TIS	2.3	3.4	7.0	11.2		
ALL Navy	TIG	1.3	1.8	4.7	5.7	5.0	4.6
GSE	TIG	1.1	1.3	3.0	4.1		

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	100.0%	69.0%	101.0%	74.0%	77.0%	91.0%
FYTD RENL Rate:	58.5%	62.5%	85.7%	96.0%		64.1%

NOTES

