
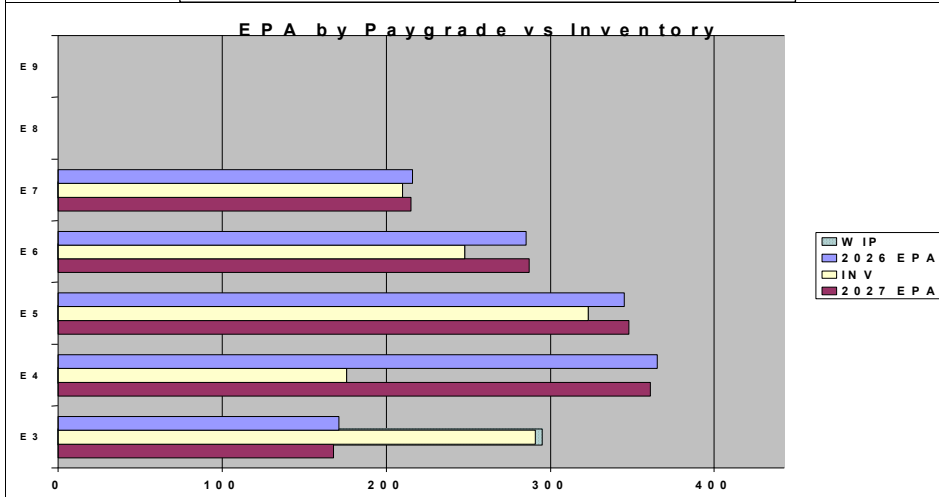


Gas Turbine Systems Technician, Electrical - B121

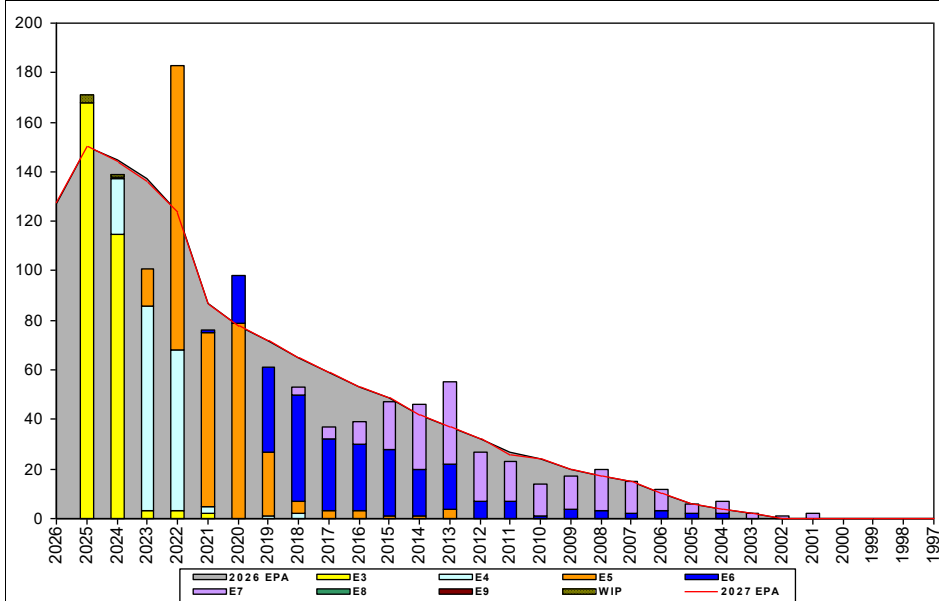

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	170%	48%	94%	87%	97%			90%
EPA (FY26)	171	365	345	285	216			1382
INVENTORY	291	176	323	248	210			1248
EPA (FY27)	168	361	348	287	215			1379
% INV to FY27 EPA	173%	49%	93%	86%	98%			91%
INV +WIP / FY26 EPA	173%							91%
INVENTORY	295	4	← E-3 and Below WIP					1252
INV +WIP / FY26 EPA	176%							91%

Sea Shore Flow

TOUR	SEA	SHORE
1ST	52	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA

PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
E1-3	107.4%	102	95	900.0%	9	1	115.6%	111	96
E4	48.8%	159	326	50.0%	11	22	48.9%	170	348
E5	146.3%	237	162	49.0%	74	151	99.4%	311	313
E6	51.7%	90	174	154.3%	145	94	87.7%	235	268
E7	111.9%	122	109	76.5%	75	98	95.2%	197	207
E8									
E9									
Total	82.0%	710	866	85.8%	314	366	83.1%	1024	1232

TIS to PG Years

Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS	2.2	4.0	8.7	13.9	17.8	21.7
TIG to PG Years	GSE	TIS	2.3	3.4	7.1	11.2	
ALL Navy	TIG	1.3	1.9	4.7	5.8	5.0	4.7
GSE	TIG	1.1	1.4	3.0	4.1		

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	99.0%	69.0%	99.0%	73.0%	95.0%	90.0%
FYTD RENL Rate:	58.5%	61.9%	85.7%	96.0%		64.0%

NOTES

