
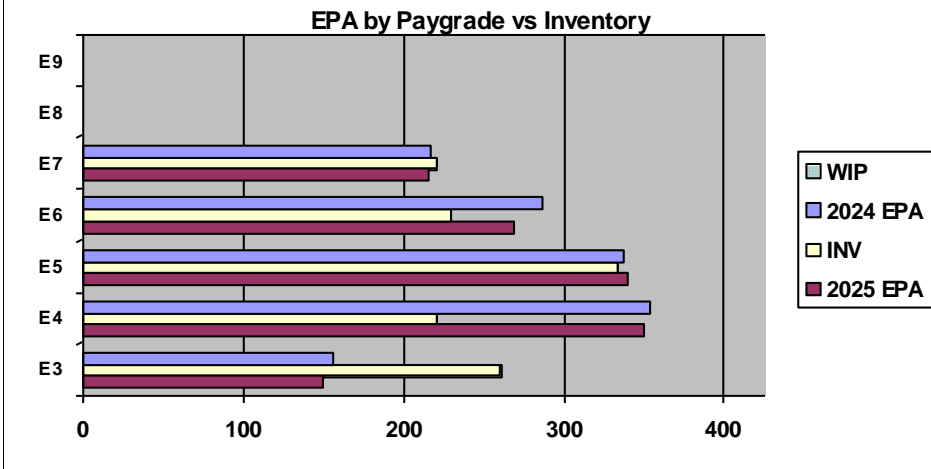


Gas Turbine Systems Technician, Electrical - B121

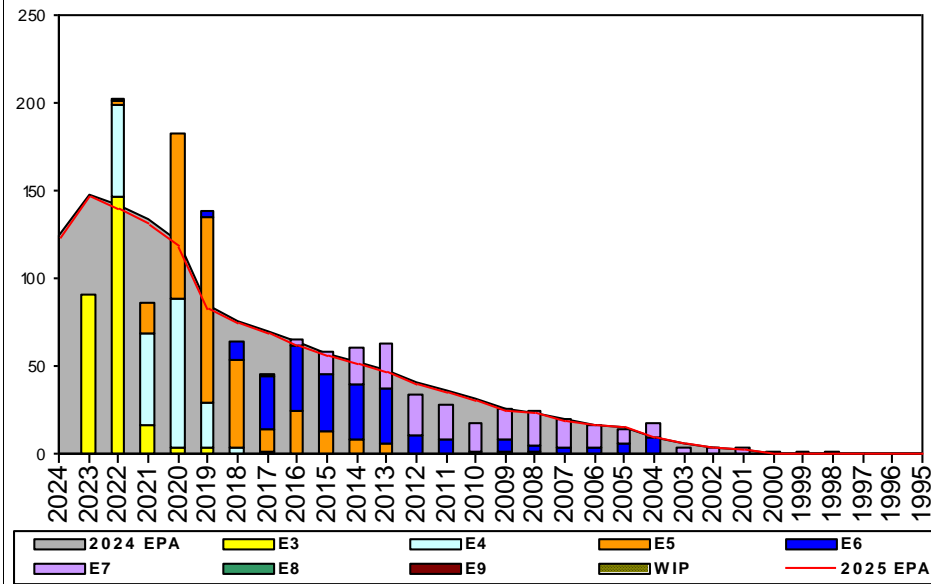

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY24 EPA	167%	62%	99%	80%	101%			94%
EPA (FY24)	156	354	337	287	217			1351
INVENTORY	260	221	334	229	220			1264
EPA (FY25)	150	350	340	269	215			1324
% INV to FY25 EPA	173%	63%	98%	85%	102%			95%
INV +WIP / FY24 EPA	167%							94%
INVENTORY	261	1						1265
INV +WIP / FY25 EPA	174%							96%

Sea Shore Flow			FORCE STRUCTURE MANNING TO BA									
TOUR	SEA	SHORE	PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
1ST	52	36	E1-3	232.9%	170	73	800.0%	8	1	240.5%	178	74
2ND	60	36	E4	62.9%	205	326	60.0%	12	20	62.7%	217	346
3RD	48	36	E5	151.3%	230	152	53.4%	78	146	103.4%	308	298
4TH	48	36	E6	43.9%	83	189	141.8%	129	91	75.7%	212	280
5TH	36	36	E7	103.5%	119	115	93.7%	89	95	99.0%	208	210
6TH	36	36	E8									
7TH	36	36	E9									
Total				94.4%	807	855	89.5%	316	353	93.0%	1123	1208

ADV OPP. (Cycles 257/258/259)						
Pay Grade	E1-3	E4	E5	E6	E7	E8
All-Navy	TIR	50.4%	27.0%	14.0%	28.8%	16.8%
GSE	TIR	32.6%	20.4%	14.6%	65.7%	0.0%

Zone Info	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY24 Manning:	100.0%	87.0%	81.0%	89.0%	71.0%	94.0%
FYTD RENL Rate:	53.3%	56.0%	71.7%	96.0%	21.4%	59.4%
FY25 Manning:	102.0%	89.0%	83.0%	91.0%	75.0%	95.5%

NOTES

Career Waypoint / My Navy Assignments (MNA) information:

This PACT rating is currently available for YG 2021. ****GSE is an "A" school required rating. ****

Convert-in opportunities can be viewed from the MNA landing page

NO convert out opportunities based on undermanned community inventory.

**** NEC U07A- Marine Gas Turbine Inspector (MGTI) ****

Looking for highly qualified and motivated GS's for the Marine Gas Turbine Inspection Program (MGTI). If interested contact your local MGTI for more information.

****IF A SAILOR WHO DESIRES TO RE-ENLIST AND DOES NOT HAVE A RE-ENLISTMENT QUOTA, PLEASE CONTACT THE ENLISTED COMMUNITY MANAGER TO DISCUSS OPTIONS. ****