
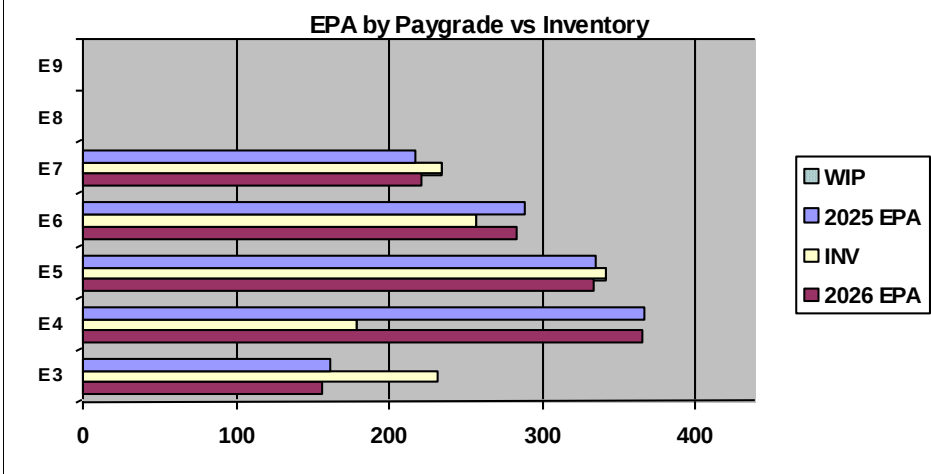


Gas Turbine Systems Technician, Electrical - B121

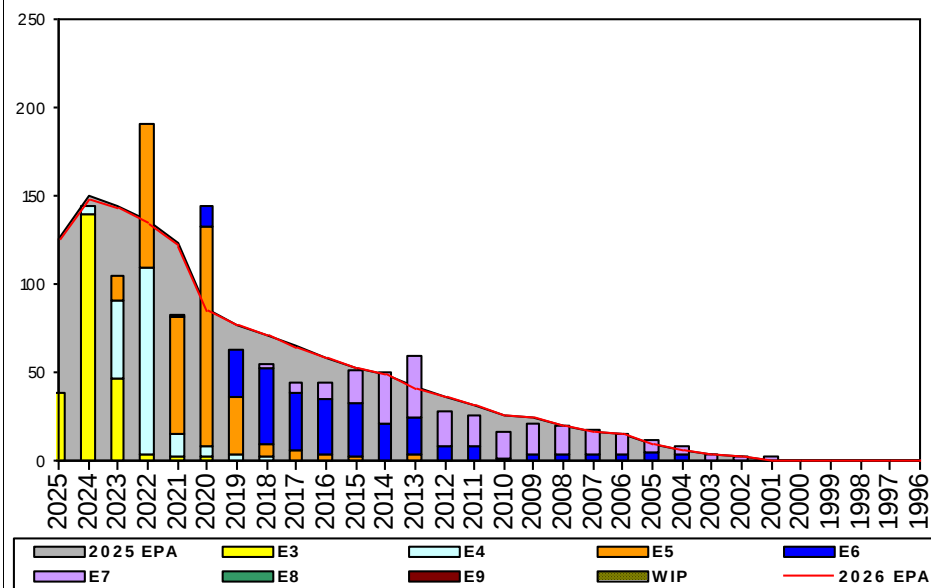

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY25 EPA	143%	49%	102%	89%	108%			91%
EPA (FY25)	162	366	335	288	217			1368
INVENTORY	232	178	341	256	234			1241
EPA (FY26)	156	365	334	283	221			1359
% INV to FY26 EPA	143%	49%	102%	89%	108%			91%
INV +WIP / FY25 EPA								
INVENTORY			← E-3 and Below WIP					
INV +WIP / FY26 EPA								

Sea Shore Flow			FORCE STRUCTURE MANNING TO BA									
TOUR	SEA	SHORE	PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
1ST	52	36	E1-3	79.3%	73	92	700.0%	7	1	86.0%	80	93
2ND	60	36	E4	48.2%	157	326	59.1%	13	22	48.9%	170	348
3RD	48	36	E5	162.6%	265	163	37.7%	57	151	102.5%	322	314
4TH	48	36	E6	55.6%	100	180	147.4%	143	97	87.7%	243	277
5TH	36	36	E7	115.2%	129	112	85.9%	85	99	101.4%	214	211
6TH	36	36	E8									
7TH	36	36	E9									
Total				82.9%	724	873	82.4%	305	370	82.8%	1029	1243

ADV OPP. (Cycles 261/262/264)

Pay Grade	E1-3	E4	E5	E6	E7	E8	E9
All-Navy	TIR	TIR	18.54	10.62%	31.44%	21.60%	22.32%
GSE	TIR	44.4%	98.6%	100.0%	66.2%	0.0%	0.0%

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY25 Manning:	97.0%	75.0%	91.0%	87.0%	76.0%	91.0%
FYTD RENL Rate:	60.3%	45.8%	66.7%	91.7%		58.9%
FY26 Manning:	98.0%	75.0%	92.0%	87.0%	76.0%	91.3%

NOTES

SRB

NEC U16A: Zone B/C \$45k
(visit <https://www.mynavyhr.navy.mil/> for additional information)

SDIP

GSE E-4 \$300/ GSE E-6 \$500/ GSE E-7 \$600
(visit <https://www.mynavyhr.navy.mil/> for additional information)
Career Waypoint / My Navy Assignments (MNA) information:
This PACT rating is currently available for YG 2021. ****GSE is an "A" school required rating.*****

Convert-in opportunities can be viewed from the MNA landing page
Rating conversions will be considered on a case-by-case basis
**** NEC U07A- Marine Gas Turbine Inspector (MGTI) ****
Looking for highly qualified and motivated GS's for MGTI program. If interested contact your local MGTI for more information