



# Gas Turbine Systems Technician, Electrical - B121

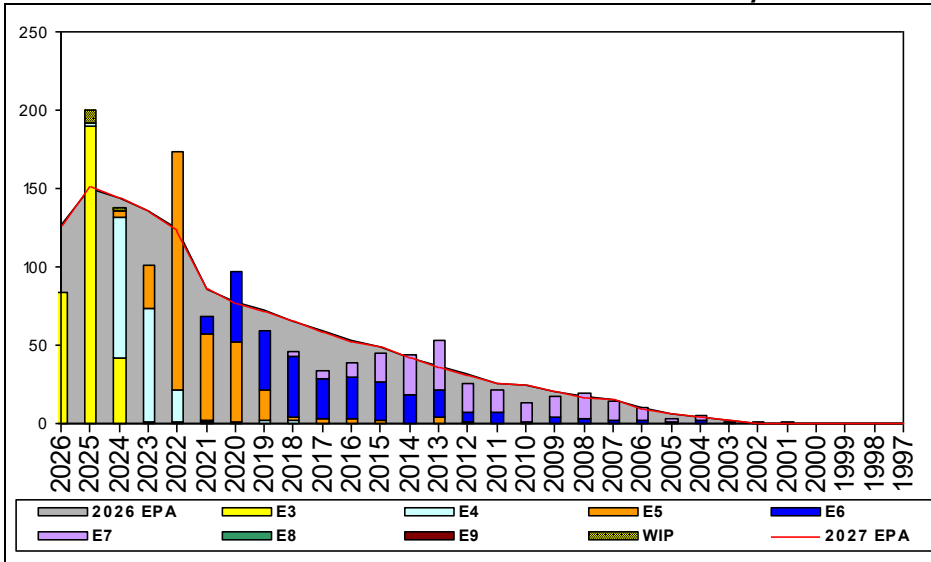

Sea Shore Flow		
TOUR	SEA	SHORE
1ST	52	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA										
PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA	
E1-3	130.5%	124	95	1300.0%	13	1	142.7%	137	96	
E4	53.5%	175	327	45.5%	10	22	53.0%	185	349	
E5	147.5%	239	162	45.4%	69	152	98.1%	308	314	
E6	64.0%	110	172	160.9%	148	92	97.7%	258	264	
E7	100.0%	108	108	73.2%	71	97	87.3%	179	205	
E8										
E9										
<b>Total</b>	<b>87.5%</b>	<b>756</b>	<b>864</b>	<b>85.4%</b>	<b>311</b>	<b>364</b>	<b>86.9%</b>	<b>1067</b>	<b>1228</b>	

TIS to PG Years	Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
	ALL Navy	TIS		2.2	4.0	8.7	13.8	17.9
TIG to PG Years	GSE	TIS	2.4	3.5	7.0	11.1		
	ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
	GSE	TIG	1.1	1.3	3.0	4.0		

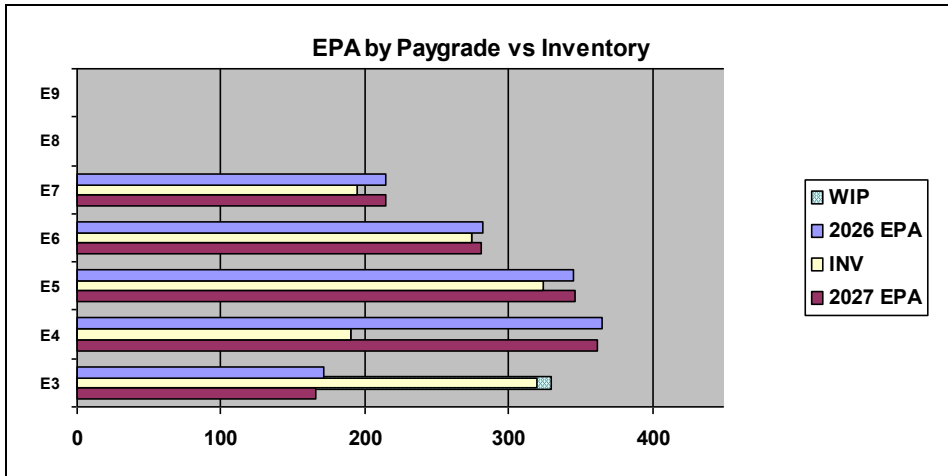

Zone Info	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
<b>FY26 Manning:</b>	<b>104.0%</b>	<b>71.0%</b>	<b>104.0%</b>	<b>78.0%</b>	<b>64.0%</b>	<b>94.0%</b>
<b>FYTD RENL Rate:</b>	58.5%	62.5%	85.7%	96.0%		64.1%

## NOTES

Convert-in opportunities can be viewed from MNA landing page.  
 Convert-outs are adjudicated based on a case by case basis off overall community health and manning.  
**Conversion window is 18-13 months from PRD.**  
 This PACT rating is currently unavailable.

\*\*\*SRB\*\*\*  
 -NEC U16A Zone B and C

\*\*\*SDIP\*\*  
 -GSE E4, E6 and E7

\*\*\*SDAP\*\*\*  
 -U16A  
 -U07A

For questions feel free to reach out [maya.m.gengenbacher.mil@us.navy.mil](mailto:maya.m.gengenbacher.mil@us.navy.mil)

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
<b>% INV to FY26 EPA</b>	<b>187%</b>	<b>52%</b>	<b>94%</b>	<b>97%</b>	<b>91%</b>			<b>94%</b>
<b>EPA (FY26)</b>	171	365	345	282	215			1378
<b>INVENTORY</b>	319	190	324	274	195			1302
<b>EPA (FY27)</b>	166	361	346	281	215			1369
<b>% INV to FY27 EPA</b>	<b>192%</b>	<b>53%</b>	<b>94%</b>	<b>98%</b>	<b>91%</b>			<b>95%</b>
<b>INV + WIP / FY26 EPA</b>	<b>192%</b>							<b>95%</b>
<b>INVENTORY</b>	329	10 ← E-3 and Below WIP						1312
<b>INV + WIP / FY26 EPA</b>	<b>198%</b>							<b>96%</b>