



Gas Turbine Systems Technician, Electrical - B121

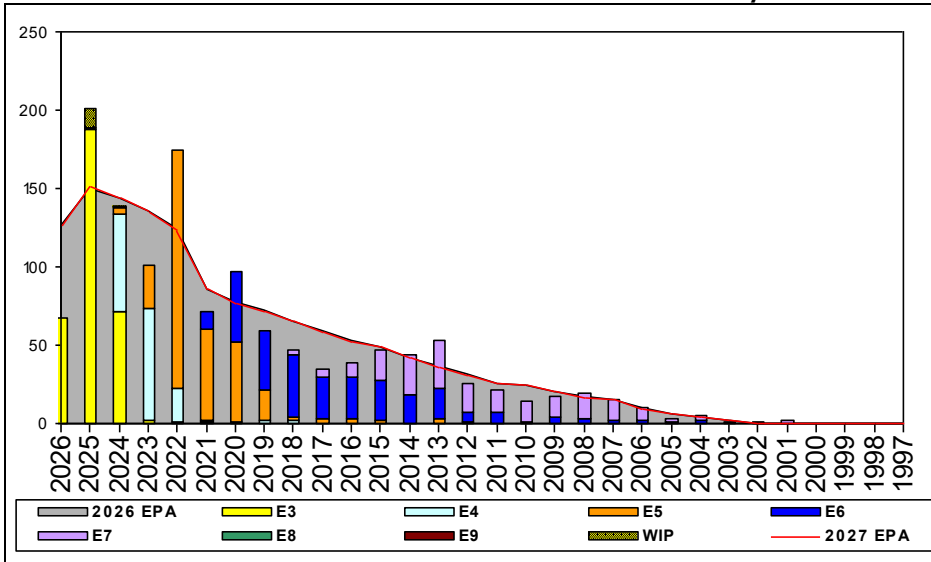

Sea Shore Flow		
TOUR	SEA	SHORE
1ST	52	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA										
PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA	
E1-3	144.2%	137	95	1200.0%	12	1	155.2%	149	96	
E4	46.2%	151	327	36.4%	8	22	45.6%	159	349	
E5	149.4%	242	162	46.4%	70	151	99.7%	312	313	
E6	65.1%	112	172	164.5%	153	93	100.0%	265	265	
E7	104.6%	113	108	72.2%	70	97	89.3%	183	205	
E8										
E9										
Total	87.4%	755	864	86.0%	313	364	87.0%	1068	1228	

TIS to PG Years	Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
	ALL Navy	TIS	2.2	4.0	8.7	13.8	17.8	21.7
TIG to PG Years	GSE	TIS	2.4	3.5	7.0	11.1		
	ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
	GSE	TIG	1.2	1.4	3.0	4.1		

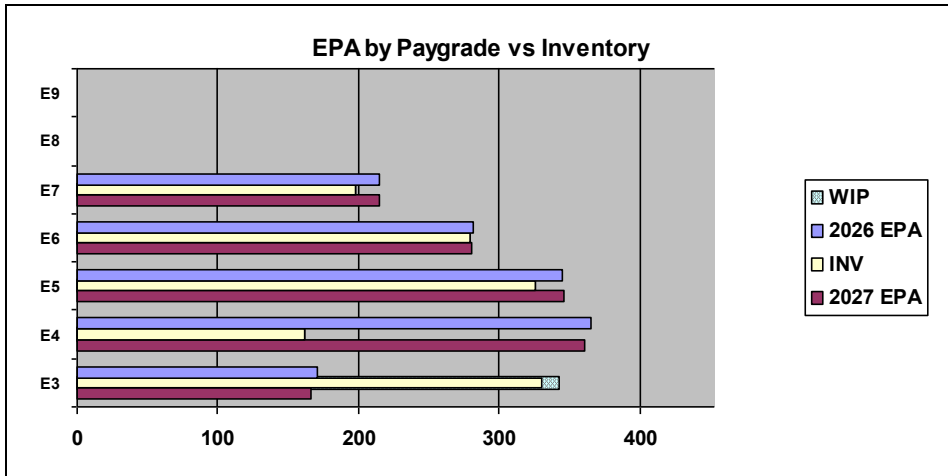

Zone Info	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	104.0%	71.0%	104.0%	77.0%	68.0%	94.0%
FYTD RENL Rate:	58.5%	62.5%	85.7%	96.0%		64.1%

NOTES

Convert-in opportunities can be viewed from MNA landing page.
 Convert-outs are adjudicated based on a case by case basis off overall community health and manning.
 Conversion window is 18-13 months from PRD.
 This PACT rating is currently unavailable.

SRB
 -NEC U16A Zone B and C

SDIP
 -GSE E4, E6 and E7

SDAP
 -U16A
 -U07A

For questions feel free to reach out maya.m.gengenbacher.mil@us.navy.mil

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	193%	44%	94%	99%	92%			94%
EPA (FY26)	171	365	345	282	215			1378
INVENTORY	330	162	326	279	198			1295
EPA (FY27)	166	361	346	281	215			1369
% INV to FY27 EPA	199%	45%	94%	99%	92%			95%
INV + WIP / FY26 EPA	201%							95%
INVENTORY	343	13 ← E-3 and Below WIP						1308
INV + WIP / FY26 EPA	207%							96%