


Gas Turbine Systems Technician, Electrical - B121

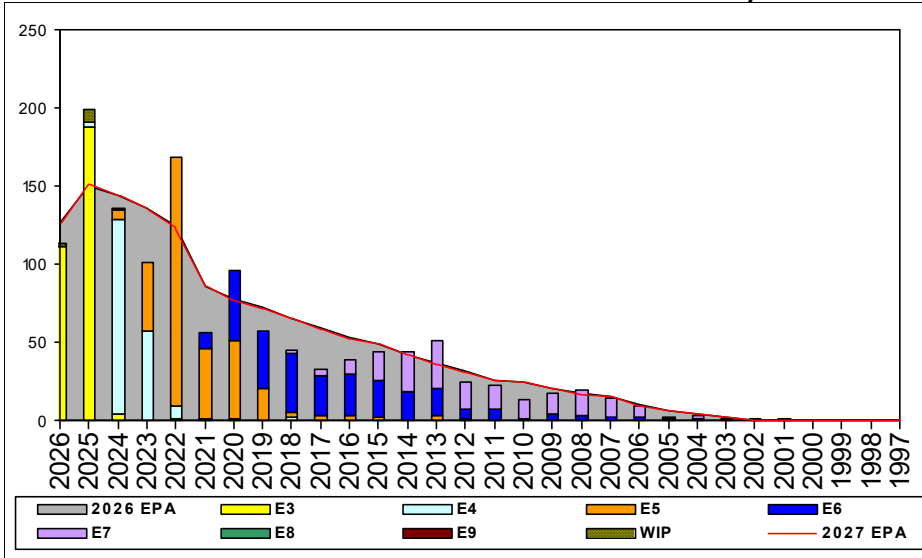

Sea Shore Flow

TOUR	SEA	SHORE
1ST	52	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA

PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
E1-3	140.0%	133	95	1100.0%	11	1	150.0%	144	96
E4	54.7%	179	327	72.7%	16	22	55.9%	195	349
E5	150.6%	244	162	50.0%	76	152	101.9%	320	314
E6	57.6%	99	172	153.8%	140	91	90.9%	239	263
E7	95.4%	103	108	68.0%	66	97	82.4%	169	205
E8									
E9									
Total	87.7%	758	864	85.1%	309	363	87.0%	1067	1227

TIS to PG Years

Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS	2.2	4.0	8.7	13.8	17.8	21.7
GSE	TIS	2.4	3.6	6.9	11.0		
ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
GSE	TIG	1.2	1.4	3.0	4.0		

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	102.0%	77.0%	102.0%	79.0%	55.0%	94.0%
FYTD RENL Rate:	79.4%	69.7%	96.9%	93.3%	8.3%	76.9%

NOTES

Conversion window is 18-13 months from PRD.
Convert-in opportunities can be viewed from MNA landing page.
Convert-outs are adjudicated based on a case by case basis off overall community health and manning.

This PACT rating is currently unavailable.

SRB

-NEC U16A Zone B and C

SDIP

-GSE E4, E6 and E7

SDAP

-NEC U16A


-NEC U07A

For questions feel free to reach out maya.m.gengenbacher.mil@us.navy.mil

Data Source: NMPBS(Inv)/NRMS(RE Rate)/N12(EPA/SSF)

As of Date: 17-Jul-26

EPA by Paygrade vs Inventory

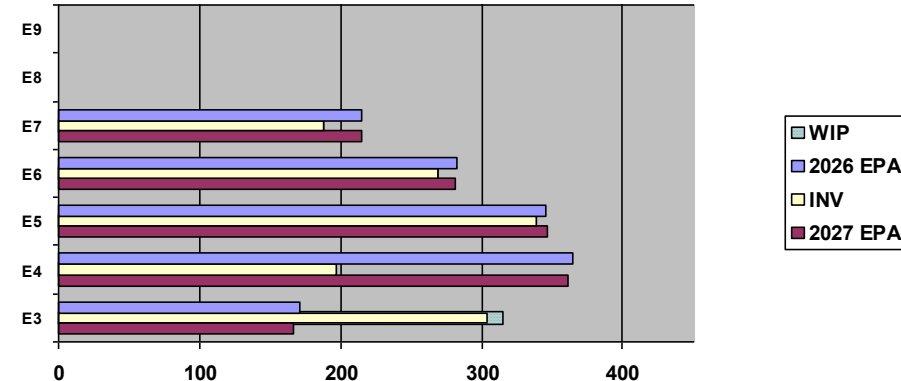

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	178%	54%	98%	95%	87%			94%
EPA (FY26)	171	365	345	282	215			1378
INVENTORY	304	197	339	269	188			1297
EPA (FY27)	166	361	346	281	215			1369
% INV to FY27 EPA	183%	55%	98%	96%	87%			95%
INV + WIP / FY26 EPA	184%							95%
INVENTORY	315	11						1308
INV + WIP / FY26 EPA	190%							96%