



Gas Turbine Systems Technician, Mechanical - B122

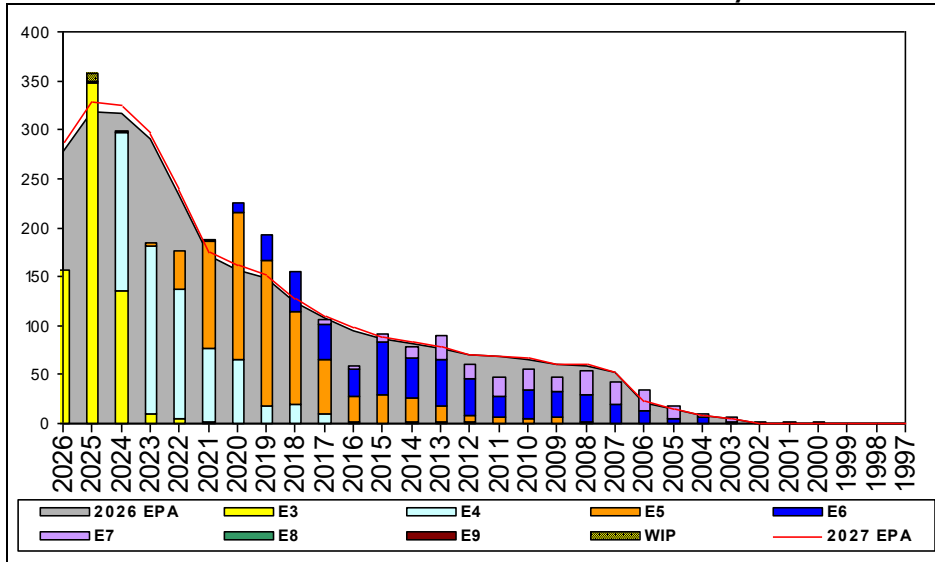

Sea Shore Flow		
TOUR	SEA	SHORE
1ST	54	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA										
PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA	
E1-3	117.0%	407	348	100.0%	15	15	116.3%	422	363	
E4	65.6%	527	803	247.4%	94	38	73.8%	621	841	
E5	72.7%	380	523	112.4%	281	250	85.5%	661	773	
E6	95.0%	246	259	91.1%	194	213	93.2%	440	472	
E7	75.0%	90	120	77.8%	112	144	76.5%	202	264	
E8										
E9										
Total	80.4%	1650	2053	105.5%	696	660	86.5%	2346	2713	

TIS to PG Years	Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
	ALL Navy	TIS	2.2	4.0	8.7	13.8	17.8	21.7
TIG to PG Years	GSM	TIS	2.4	4.5	9.1	13.2		
	ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
	GSM	TIG	1.2	2.2	4.8	4.5		

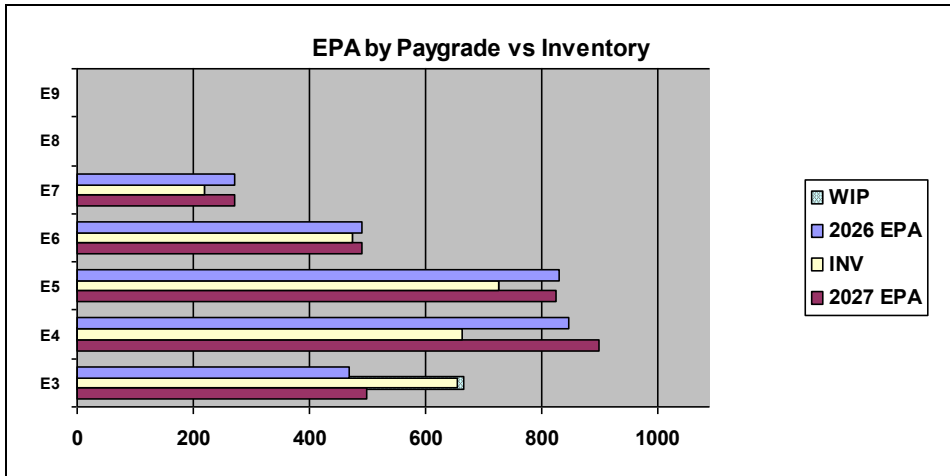

Zone Info	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	91.0%	112.0%	98.0%	78.0%	114.0%	94.0%
FYTD RENL Rate:	57.1%	60.7%	86.8%	98.4%	21.4%	63.7%

NOTES

Convert-in opportunities can be viewed from MNA landing page.
 Convert-outs are adjudicated based on a case by case basis off overall community health and manning.
 Conversion window is 18-13 months from PRD.

This PACT rating is currently available.

SRB
 -NEC U12A Zone A, B and C

SDIP
 -GSM E7

SDAP
 -U16A
 -U07A

For questions feel free to reach out maya.m.gengenbacher.mil@us.navy.mil

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	140%	78%	87%	97%	80%			94%
EPA (FY26)	467	846	830	489	272			2904
INVENTORY	655	662	725	474	218			2734
EPA (FY27)	498	898	823	490	271			2980
% INV to FY27 EPA	132%	74%	88%	97%	80%			92%
INV + WIP / FY26 EPA	142%							94%
INVENTORY	665	10 ← E-3 and Below WIP						2744
INV + WIP / FY26 EPA	134%							92%