


Gas Turbine Systems Technician, Mechanical - B122

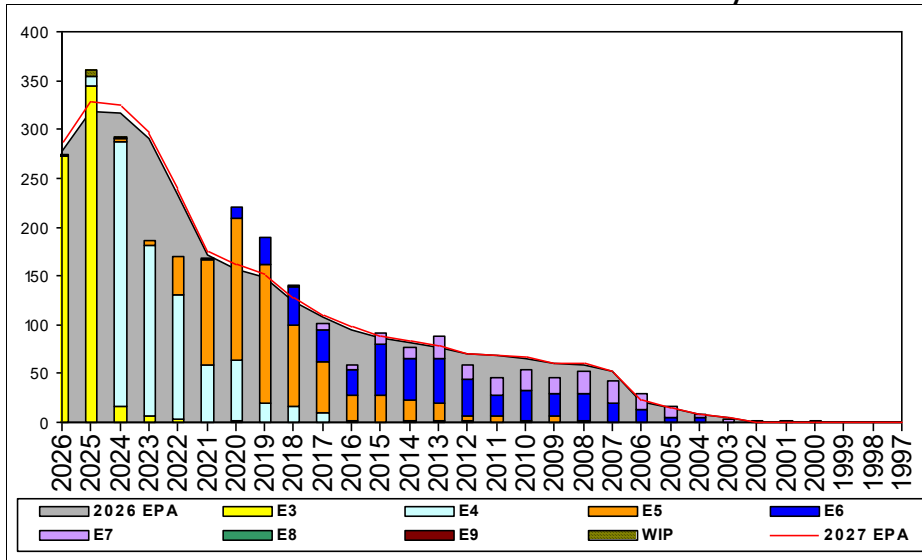

Sea Shore Flow

TOUR	SEA	SHORE
1ST	54	36
2ND	60	36
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA

PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
E1-3	105.5%	367	348	106.7%	16	15	105.5%	383	363
E4	76.7%	616	803	247.4%	94	38	84.4%	710	841
E5	69.0%	361	523	109.2%	274	251	82.0%	635	774
E6	96.5%	250	259	84.3%	177	210	91.0%	427	469
E7	77.7%	94	121	74.5%	108	145	75.9%	202	266
E8									
E9									
Total	82.2%	1688	2054	101.5%	669	659	86.9%	2357	2713

TIS to PG Years

Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS	2.2	4.0	8.7	13.8	17.8	21.7
GSM	TIS	2.4	4.5	9.2	13.2		
ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
GSM	TIG	1.2	2.3	4.9	4.5		

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	93.0%	113.0%	96.0%	79.0%	114.0%	95.0%
FYTD RENL Rate:	65.5%	63.3%	75.7%	100.0%	25.0%	65.8%

NOTES

Conversion window is 18-13 months from PRD.
 Convert-in opportunities can be viewed from MNA landing page.
 Convert-outs are adjudicated based on a case by case basis off overall community health and manning.
 This PACT rating is currently available.

SRB

-NEC U12A Zone A, B and C

SDIP

-GSM E7

SDAP


-U16A
-U07A

For questions feel free to reach out maya.m.gengenbacher.mil@us.navy.mil

Data Source: NMPBS(Inv)/NRMS(RE Rate)/N12(EPA/SSF)

As of Date: 17-Jul-26

EPA by Paygrade vs Inventory

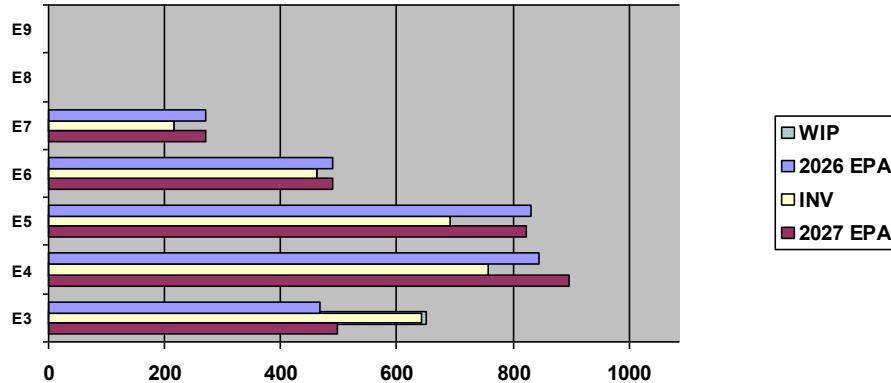

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA	138%	89%	83%	94%	79%			95%
EPA (FY26)	467	846	830	489	272			2904
INVENTORY	643	757	693	462	216			2771
EPA (FY27)	498	898	823	490	271			2980
% INV to FY27 EPA	129%	84%	84%	94%	80%			93%
INV + WIP / FY26 EPA	140%							96%
INVENTORY	652	9						2780
INV + WIP / FY26 EPA	131%							93%

9 ← E-3 and Below WIP