



Gas Turbine Systems Technician - B120

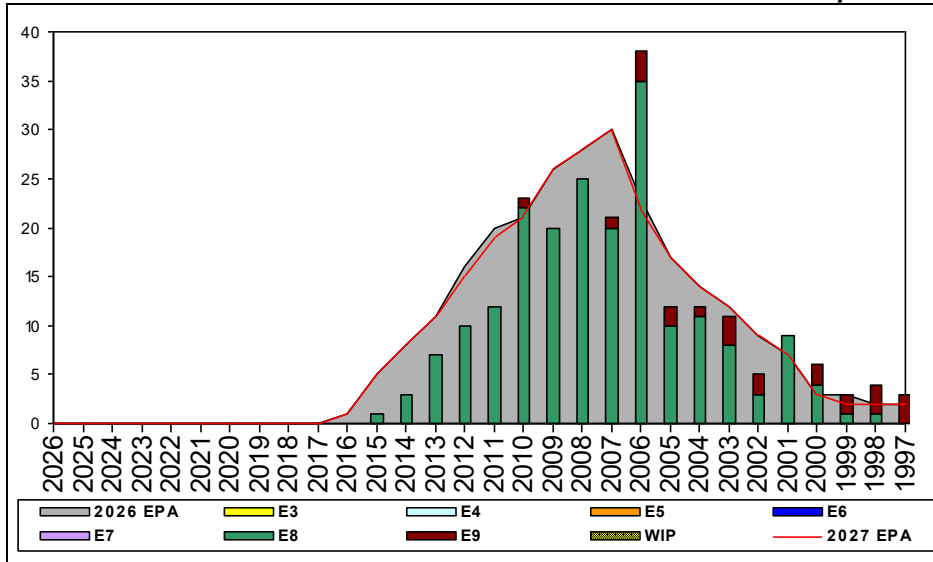

Sea Shore Flow		
TOUR	SEA	SHORE
1ST		
2ND		
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA										
PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA	
E1-3										
E4										
E5										
E6										
E7										
E8	87.2%	102	117	91.5%	97	106	89.2%	199	223	
E9	142.9%	10	7	81.0%	17	21	96.4%	27	28	
Total	90.3%	112	124	89.8%	114	127	90.0%	226	251	

TIS to PG Years	Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS		2.2	4.0	8.7	13.8	17.9	21.8
	GS						16.0	21.8
	TIG		1.3	1.8	4.6	5.7	5.0	4.6
TIG to PG Years	GS						4.2	6.0
	TIG							

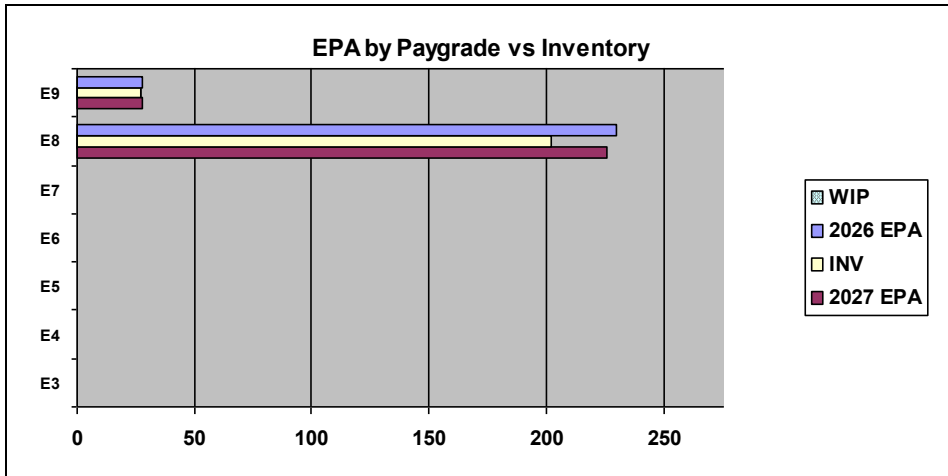

Zone Info		ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:			56.0%	91.0%	93.0%	89.0%	
FYTD RENL Rate:			75.0%	100.0%	34.0%	52.2%	

NOTES

SDIP ***SDAP***
 GS E9 -NEC U16A
 -NEC U07A

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA						88%	96%	89%
EPA (FY26)						230	28	258
INVENTORY						202	27	229
EPA (FY27)						226	28	254
% INV to FY27 EPA						89%	96%	90%
INV + WIP / FY26 EPA								
INVENTORY			← E-3 and Below WIP					
INV + WIP / FY26 EPA								