


Gas Turbine Systems Technician - B120

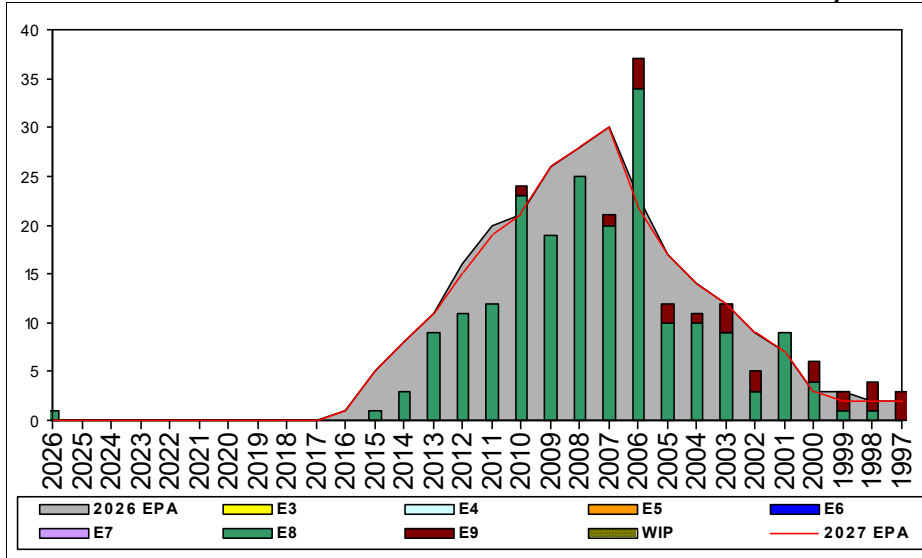

Sea Shore Flow

TOUR	SEA	SHORE
1ST		
2ND		
3RD	48	36
4TH	48	36
5TH	36	36
6TH	36	36
7TH	36	36

FORCE STRUCTURE MANNING TO BA

PG	SEA	INV	BA	SHORE	INV	BA	SEA + SHORE	TOTAL INV	TOTAL BA
E1-3									
E4									
E5									
E6									
E7									
E8	87.2%	102	117	92.5%	98	106	89.7%	200	223
E9	128.6%	9	7	90.0%	18	20	100.0%	27	27
Total	89.5%	111	124	92.1%	116	126	90.8%	227	250

TIS to PG Years

Pay Grade	E1-E3	E4	E5	E6	E7	E8	E9
ALL Navy	TIS	2.2	4.0	8.7	13.8	17.8	21.7
GS	TIS					16.0	21.8
TIG to PG Years	ALL Navy	TIG					
ALL Navy	TIG	1.3	1.8	4.6	5.7	5.0	4.6
GS	TIG					4.2	6.0

Zone Info

	ZONE A	ZONE B	ZONE C	ZONE D	ZONE E	ALL ZONES
FY26 Manning:	0.0%		64.0%	85.0%	103.0%	90.0%
FYTD RENL Rate:				100.0%	17.2%	33.3%

NOTES

SDIP

GS E9

SDAP


-NEC U16A

-NEC U07A

Data Source: NMPBS(Inv)/NRMS(RE Rate)/N12(EPA/SSF)

As of Date: 17-Jul-26

EPA by Paygrade vs Inventory

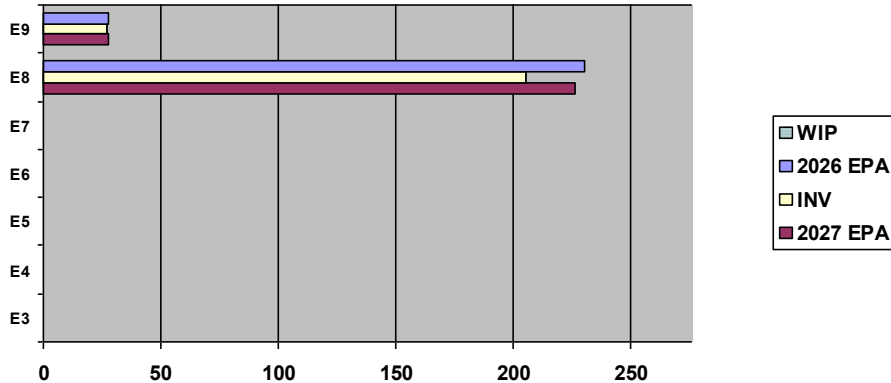

	E1-3	E4	E5	E6	E7	E8	E9	TOTAL
% INV to FY26 EPA						89%	96%	90%
EPA (FY26)						230	28	258
INVENTORY						205	27	232
EPA (FY27)						226	28	254
% INV to FY27 EPA						91%	96%	91%
INV +WIP / FY26 EPA								
INVENTORY								
INV +WIP / FY26 EPA								

← E-3 and Below WIP